


# CIVIL COMMENTS COMPLETE -- EA (20251112)

ELECTRICAL  
HAS BEEN  
UPDATED - SEE  
SHEET 22

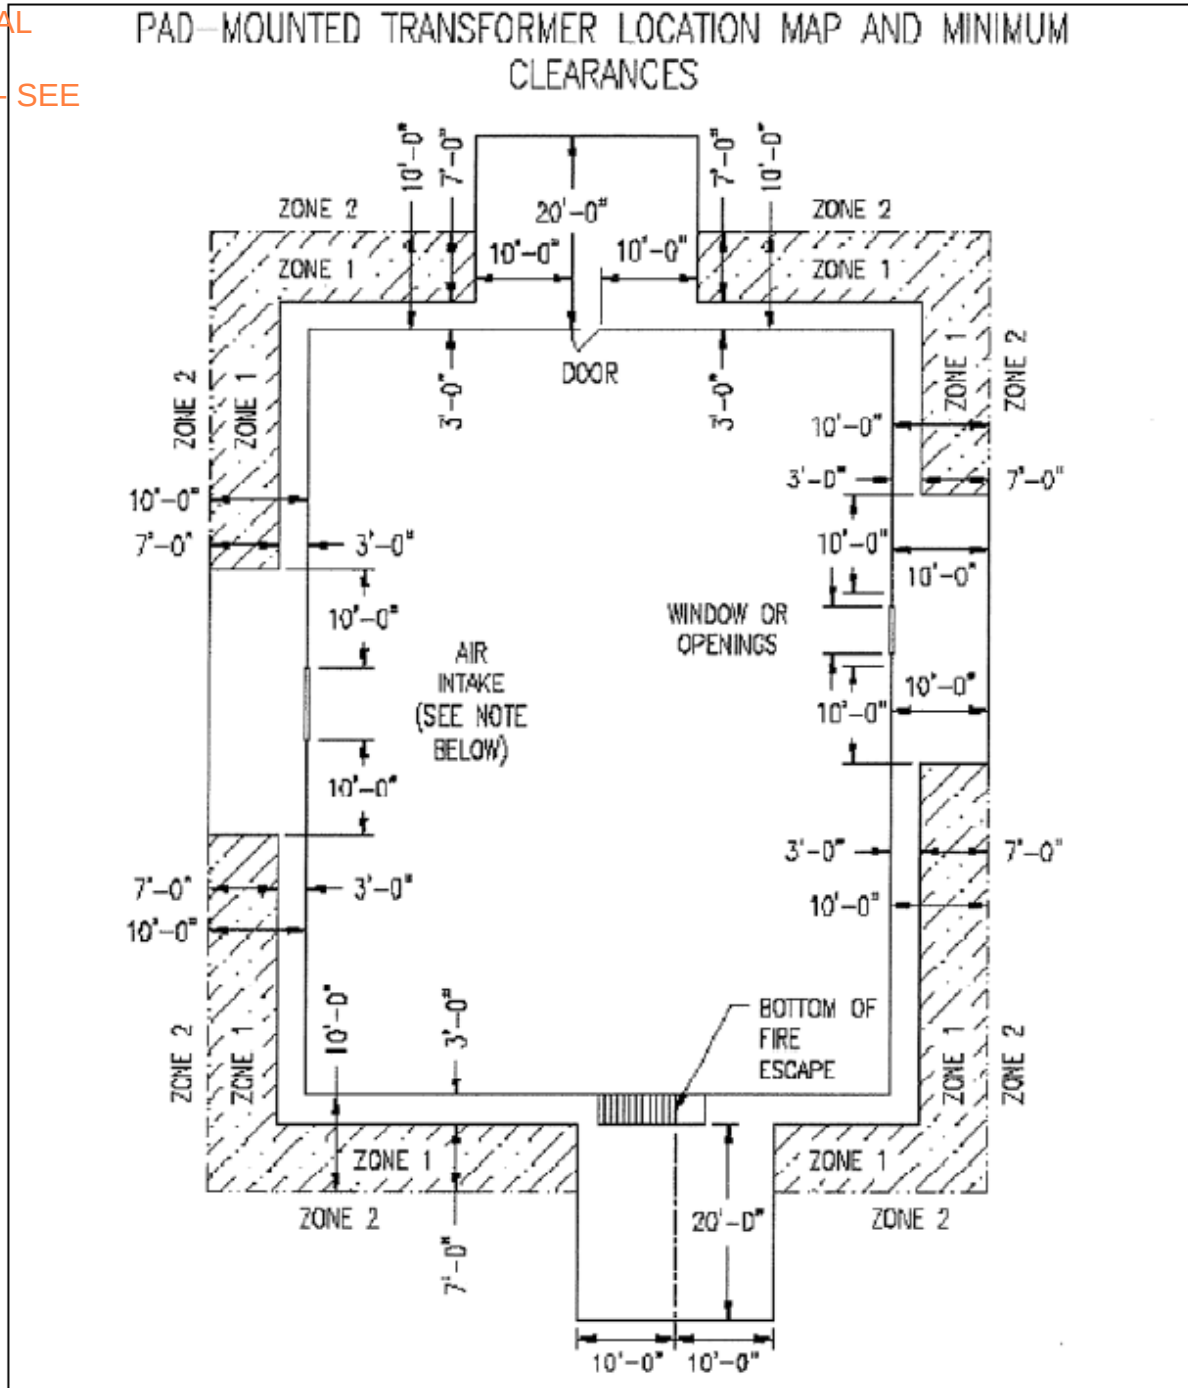

## NOTES:

ZONE 1 (Shaded Area) = Minimum distance for pad-mounted transformer from a non-combustible building.

ZONE 2 = Minimum distance for pad-mounted transformers from a combustible building.

Air intake clearance must be a minimum of 25 feet diagonal from transformer (not shown). additional clearances are shown on Minimum Distances for Pad-Mount Transformers drawing.